
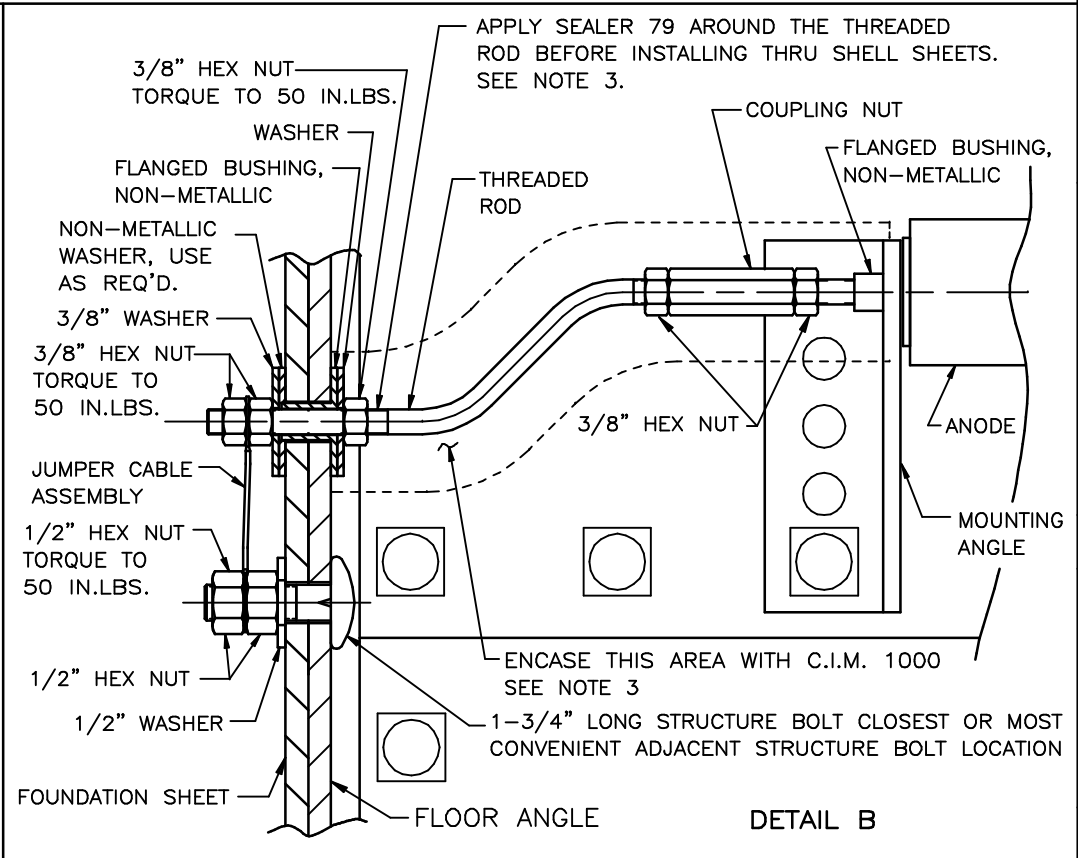


USAGE AQUASTORE STEEL FLOOR FOUNDATION
PLAN VIEW OF ANODE IN ASSEMBLED POSITION

- NOTES:
- EQUALLY SPACE THE PRIMARY ANODES AROUND THE INSIDE PERIMETER OF THE TANK. INSTALL ONE END OF THE THREADED ROD THRU A BOLT HOLE IN THE FOUNDATION SHEET / FLOOR ANGLE HORIZONTAL BOLT LINE.
 - ADD-ON ANODES TO BE INSTALLED AS SHOWN IN VIEW A-A.
 - ALL SEALER 79 AND C.I.M. 1000 USED WHEN INSTALLING THE CATHODIC PROTECTION SYSTEM IS TO BE SUPPLIED BY THE BUILDER.

REL	DESCRIPTION	ECN DR. BY
1	RELEASED FOR PRODUCTION	97263 10/14/97 DMA/RKK
2	CHANGED GLASS FLOOR TO STEEL FLOOR	99170 9/1/99 JTF/
3	REVISED TO USE ROUND WASHER INSTEAD OF HEX.	99211 1/19/00 DMA/

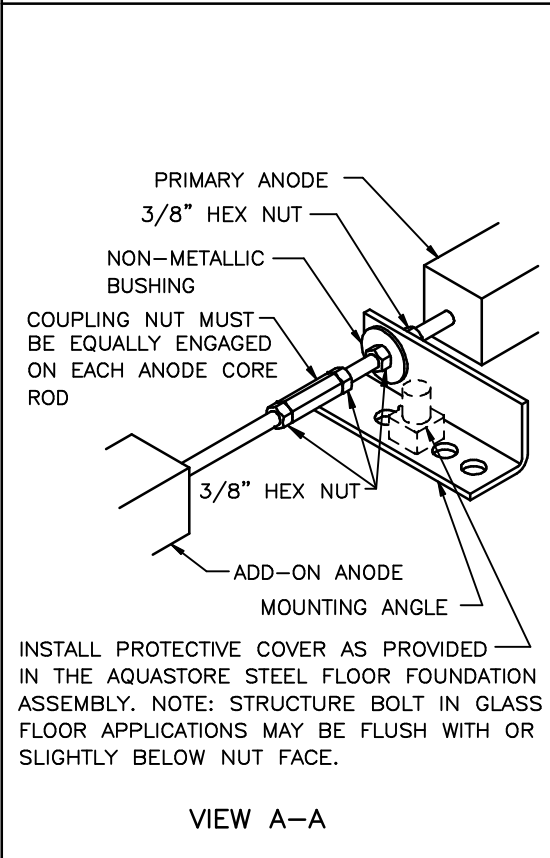

A.O. SMITH
ENGINEERED STORAGE PRODUCTS COMPANY
DEKALB, ILLINOIS 60115

CONFIDENTIAL
THIS DRAWING IS THE PROPRIETARY PROPERTY OF A.O. SMITH ENGINEERED STORAGE PRODUCTS COMPANY AND SHALL NOT BE USED NOR REPRODUCED WITHOUT THE EXPRESS WRITTEN CONSENT OF THE COMPANY.
AOSESPC COPYRIGHT © 1997
ALL RIGHTS RESERVED

DRAWN BY: DMA
DATE: 10/10/97

CONSTRUCTION DETAIL
CATHODIC PROTECTION
SYSTEM INSTALLATION

STEEL FLOOR
FOUNDATIONS
ANODE ATTACHMENT

DRWG NO. 265450